
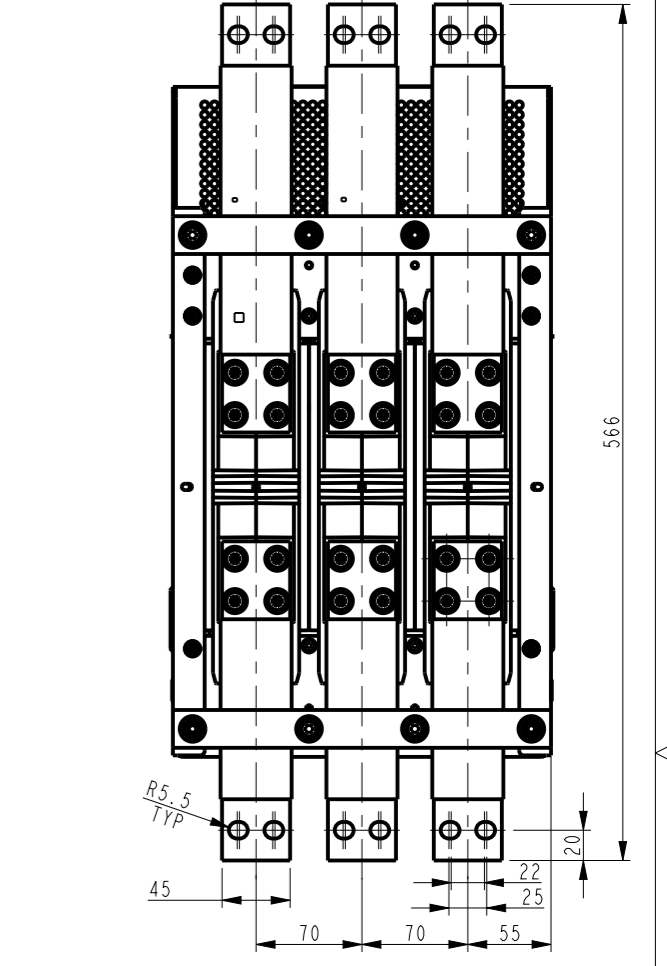


GE PROPRIETARY AND CONFIDENTIAL INFORMATION
 This document is the property of General Electric Company ("GE") and contains proprietary information of GE. This document is loaned on the express condition that neither it nor the information contained therein shall be disclosed to others without the express written consent of GE Energy, and that the information shall be used by the recipient only as approved expressly by GE Energy. This document shall be returned to GE upon its request. This document may be subject to certain restrictions under U.S. export control laws and regulations.

Article or Material Must Conform to RoHS Procedure SI900000 Sec. 13


Article or Material Must Conform to REACH Procedure SI900000 Sec. 14

REVISIONS				
REV.	DESCRIPTION	DATE	APPROVED	
1	R1329019	11/13/13	RAJEEV	RAJESH
2	C003032	02/24/15		VS
3	C035056	11/23/17	RAGHAV	SANDEEP
4	C046810	05/30/18	RAGHAV	GUPTA

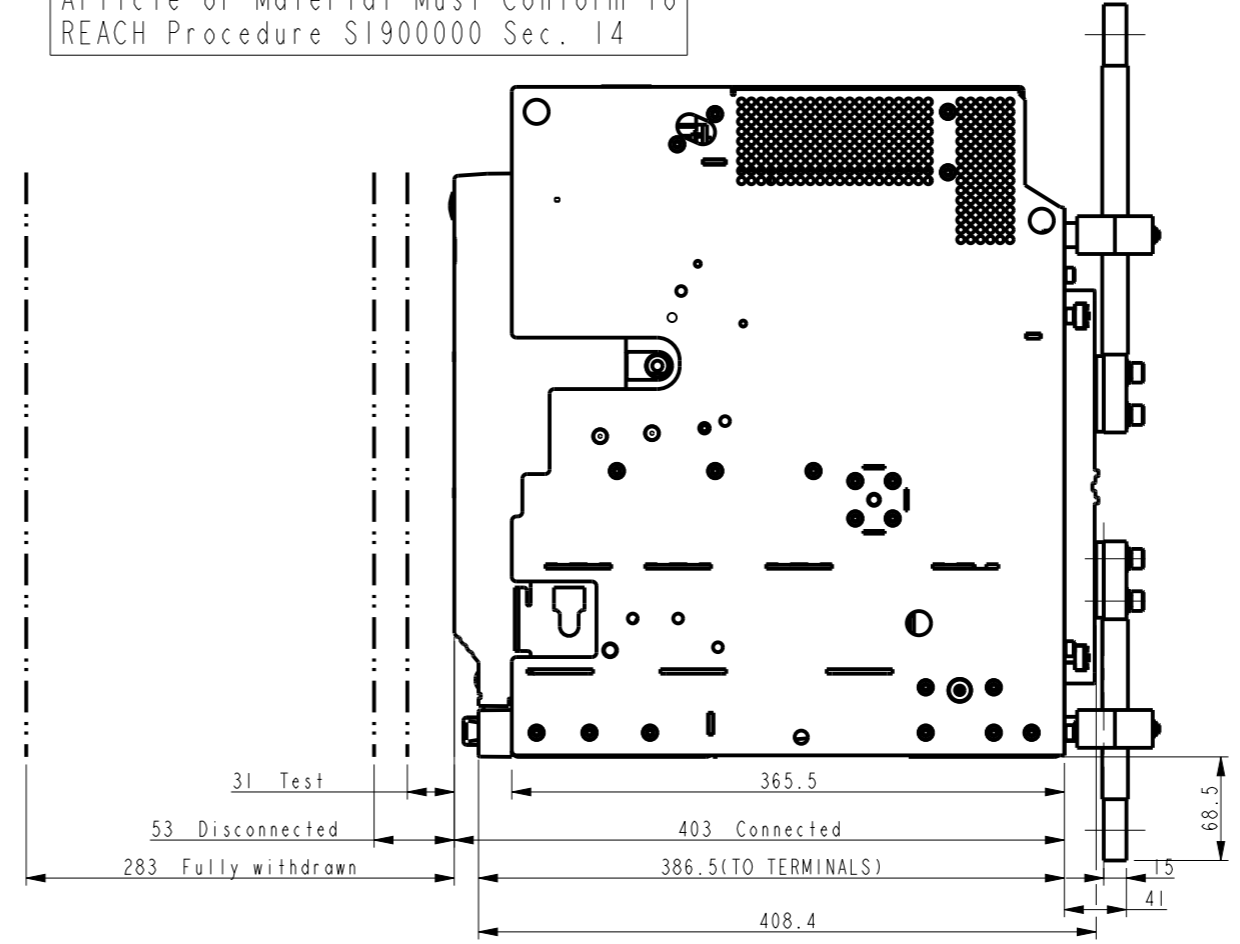

NOTE:
 COPPER WORK MUST BE SUPPORTED WITHIN 200mm OF BREAKER CONNECTIONS - BUS BAR OR CABLES
 ALL BUS BAR CONNECTIONS TO BE TIGHTENED TO 50Nm TORQUE

PV4

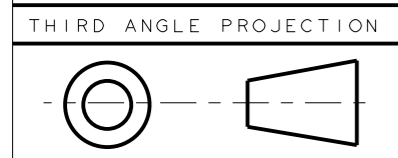

Part must conform to SI 900000 Sect. 4, Toxicity Procedure

FOR ADDITIONAL INFO REFER TO:	SIGNATURES		DATE
APPLIED PRACTICES	MODEL	RAJEEV	11/13/13
DIMENSIONS ARE IN MILLIMETERS	DETAIL	RAJEEV	11/13/13
UNLESS OTHERWISE SPECIFIED IN DRAWING	CHECKED	RAJESH	11/13/13
TOLERANCE ON:	ENGRG	.	.
1 PL DECIMALS ± 0.3	MFG	.	.
2 PL DECIMALS ± 0.13	QUALITY	.	.
ANGLES ± 0.5	ISSUED	.	.
FRACTIONS ±	DRAWING FILE:	10112622PV4	
FINISH	SOLID MODEL:	10112622PV4	
CRITICAL TO QUALITY CHARACTERISTIC			

GE Energy

TITLE: **OUTLINE CASSETTE
 FLAT FRONT
 MINIGUARD**

SIZE: A3 DRAWING: 10112622 REV: 4

SCALE: 1:5 REF. No: SHEET 1 of 1

METRIC