



# Transformer




\*1M0000000\*

Catalog Number **9T10A1885** Type **QL**


**112.5 KVA 60 HZ 3 PH 5.4 % IMP**

40 C AMB. 150 C RISE 220 C SYSTEM IS-19C

PRIMARY (H) 440 VOLTS (LINE-LINE)  
SECONDARY (X) 220 VOLTS (LINE-LINE)  
127 VOLTS (LINE-NEUTRAL)

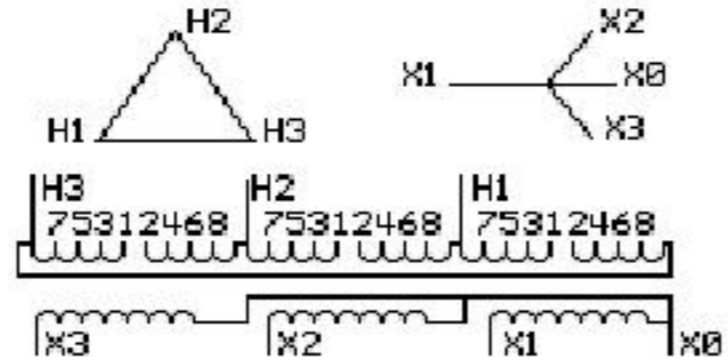

### COIL TAP ARRANGEMENT

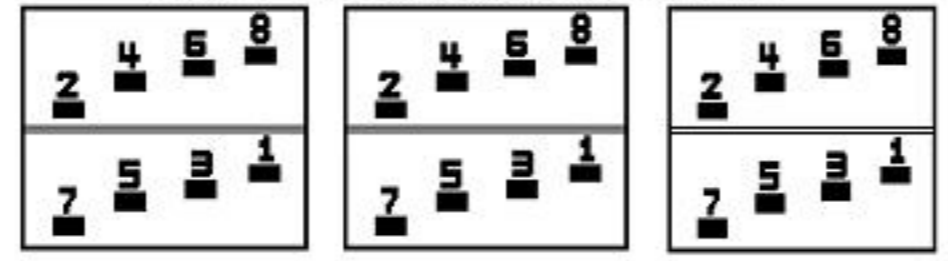

| JUMPER CONNECTION |       |
|-------------------|-------|
| TAP               | VOLTS |
| 1-2               | 463   |
| 2-3               | 451   |
| 3-4               | 440   |
| 4-5               | 430   |
| 5-6               | 418   |
| 6-7               | 406   |
| 7-8               | 397   |

NET WGT  
680 LB  
308.4 Kg

58786  
DY75A

NOG  
121715

INSPECTION  
&  
FINAL TEST  
N551!



ENCLOSURE TYPE 2 (IP20) OR RAINPROOF TYPE 3R (IP22) WHEN PROVIDED SHIELD 9T18Y1074G06

Assembled in Mexico

BEFORE HANDLING, INSTALLING AND OPERATING, SEE INSTRUCTION 475A667AAP001  
ALUMINUM CONDUCTOR PRIMARY: 10 KV BIL SECONDARY: 10 KV BIL Outline: 303B111GEDYP75A

X3 - X2 - X1 - -  
- H3 - H2 - H1

Note: X0 at the bottom

IN ACCORDANCE WITH NEC SECTION 450-9, ALLOW AT LEAST SIX INCHES CLEARANCE FOR VENTILATION. CHECK ADDITIONAL NEC AND LOCAL CODE



\*2M0000000\*



\*3M0000000\*

X3 - X2 - X1 - -  
- H3 - H2 - H1  
X3 - X2 - X1 - -  
- H3 - H2 - H1

X0