



# Transformer



\*1M000000\*

Catalog Number

Type QL


9T10C1009

500.0 KVA 60 HZ 3 PH 5.6 % IMP


40 C AMB. 150 C RISE 220 C SYSTEM IS-19C

Note: Design is based on 500.0KVA & 115C Rise 5.6% Imp.

PRIMARY (H)	480 VOLTS (LINE-LINE)
SECONDARY (X)	208 VOLTS (LINE-LINE)
	120 VOLTS (LINE-NEUTRAL)

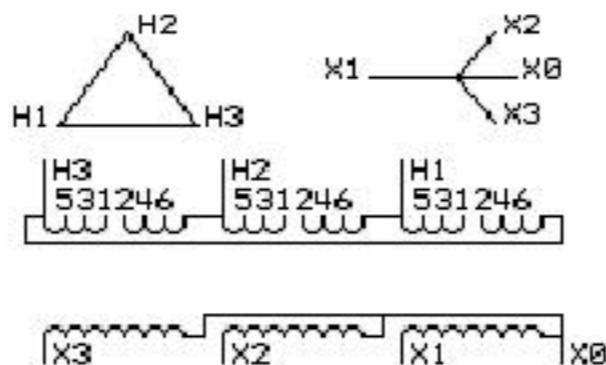

### COIL TAP ARRANGEMENT

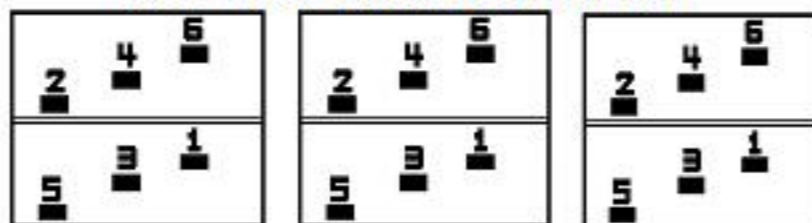

JUMPER CONNECTION	
TAP	VOLTS
1-2	500
2-3	490
3-4	480
4-5	470
5-6	460

NET WGT

3720 LB

1687.4 Kg

60294

DK79C

NOG

021016

INSPECTION & FINAL TEST N607!



Assembled in Mexico

ENCLOSURE TYPE 2 (IP20). OR RAINPROOF TYPE 3R (IP22) WHEN PROVIDED SHIELD 9T18Y1079G06

BEFORE HANDLING, INSTALLING AND OPERATING, SEE INSTRUCTION 475A667AAP001

Outline:


COPPER CONDUCTOR

PRIMARY: 10 KV BIL

SECONDARY: 10 KV BIL

303B112GEDXP79C

IN ACCORDANCE WITH NEC SECTION 450-9, ALLOW AT LEAST SIX INCHES CLEARANCE FOR VENTILATION. CHECK ADDITIONAL NEC AND LOCAL CODE

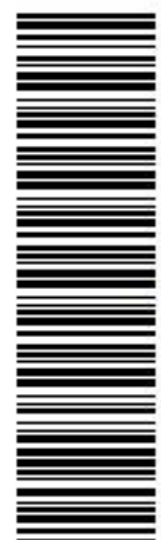

\*2M0000000\*



\*3M0000000\*