



# Transformer



\*1M000000\*

Catalog Number  
**9T12A1004G63**


Type **QL**

**75.0 KVA 60 HZ 3 PH 2 % IMP**

40 C AMB. 80 C RISE 220 C SYSTEM IS-19C

PRIMARY (H) 480 VOLTS (LINE-LINE)  
SECONDARY (X) 208 VOLTS (LINE-LINE)  
120 VOLTS (LINE-NEUTRAL)

ELECTROSTATIC GROUND SHIELD IN EACH PHASE

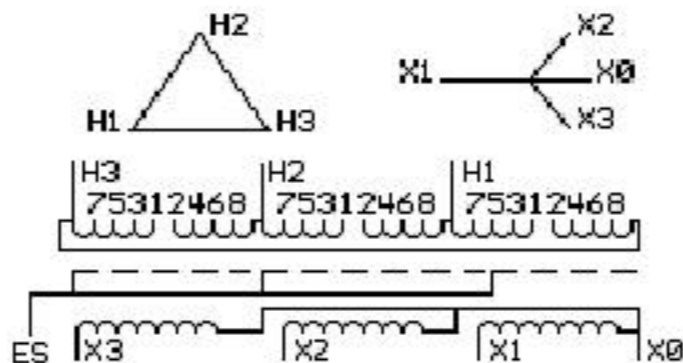

JUMPER CONNECTION	
TAP	VOLTS
1-2	506
2-3	493
3-4	480
4-5	467
5-6	455
6-7	446
7-8	433


NET WGT  
830 LB  
376.5 Kg

60802  
DK75A

NOG  
040416

INSPECTION  
&  
FINAL TEST  
N615!

### COIL TAP ARRANGEMENT

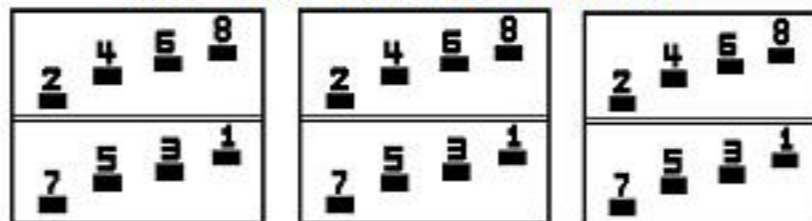

LISTED 769G

Assembled in Mexico

ENCLOSURE TYPE 2 (IP20). OR RAINPROOF TYPE 3R (IP22) WHEN PROVIDED SHIELD 9T18Y1076G06

SUITABLE FOR NONSINUSOIDAL CURRENT LOAD WITH K-FACTOR NOT TO EXCEED 20

BEFORE HANDLING, INSTALLING AND OPERATING, SEE INSTRUCTION 475A667AAP001

ALUMINUM CONDUCTOR

PRIMARY: 10 KV BIL

SECONDARY: 10 KV BIL

Outline:

303B111GEDXP75A


X3 - X2 - X1 - -  
- H3 - H2 - H1

Note: X0 at the bottom

**IN ACCORDANCE WITH NEC SECTION 450-9, ALLOW AT LEAST SIX INCHES  
CLEARANCE FOR VENTILATION. CHECK ADDITIONAL NEC AND LOCAL CODE**

X3 - X2 - X1 - -  
- H3 - H2 - H1  
X3 - X2 - X1 - -  
- H3 - H2 - H1

X0

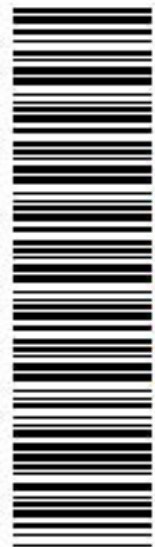

\*2M000000\*



\*3M000000\*