



# Transformer

by ABB




\*1M00046JY\*


**Catalog Number** 9T33C2673 **Type QL**

50.0 KVA 60 HZ 1 PH 4.7 % IMP  
 40 C AMB. 150 C RISE 220 C SYSTEM IS-19C

PRIMARY LINES ON H1-H2		SECONDARY LINES ON X1-X4	
VOLTS	CONNECT	VOLTS	CONNECT
215	8-H1,7-H2	430	8-7
227	6-H1,5-H2	442	7-6
240	4-H1,3-H2	454	6-5
253	2-H1,1-H2	467	5-4
		480	4-3
		493	3-2
		SECONDARY LINES ON X1-X2-X4	
		VOLTS	CONNECT
		120/240	X2-X3



### COIL TAP ARRANGEMENT



NET WGT 500 LB 226.8 Kg  
 NP1 1203202  
 INSPECTION & FINAL TEST N934!



ENCLOSURE TYPE 2 (IP20). RAINPROOF TYPE 3R ENCLOSURE (IP22) WHEN PROVIDED SHIELD 9T18Y1071G06

BEFORE HANDLING, INSTALLING AND OPERATING, SEE INSTRUCTION 475A667AAP001  
 COPPER CONDUCTOR PRIMARY: 10 KV BIL SECONDARY: 10 KV BIL  
**IN ACCORDANCE WITH NEC SECTION 450-9. ALLOW AT LEAST SIX INCHES CLEARANCE FOR VENTILATION. CHECK ADDITIONAL NEC AND LOCAL CODES.**

ASSEMBLED IN MEXICO

X3 X1 - X2 X4 -  
 - - H2 - - H1

Note:

Outline: 303B409CAP073

NEMA CLASS AA DRY TYPE TRANSFORMER

Energy Efficiency in accordance with CSA C802.2-18 and DOE 2016

X3 X1 - X2 X4 -  
 - - H2 - - H1

\*2M00046JY\*

\*3M00046JY\*



# TRANSFORMATEUR

by ABB



\*1M00046JY\*

No. Catalogue **9T33C2673** Type **QL**


**50.0 KVA**    **60 HZ**    **1 PH**    **4.7 % IMP**

**40 C AMB.**    **150 ÉLÉV. TEMP.**    **220 CLASS D'ISOL.**    **IS-19C**

PRIMARY LINES ON H1-H2		SECONDARY LINES ON X1-X4	
VOLTS	CONNECT	VOLTS	CONNECT
215	8-H1,7-H2	430	8-7
227	6-H1,5-H2	442	7-6
240	4-H1,3-H2	454	6-5
253	2-H1,1-H2	467	5-4
		480	4-3
		493	3-2
		506	2-1
		120/240	X2-X3




### ENSEMBLE DE PRISE D'ENROULEMENT



POIDS NET 500 LB  
226.8 Kg  
O

NP1 1203202  
INSPECTION & ESSAIS FINAUX  
N934!

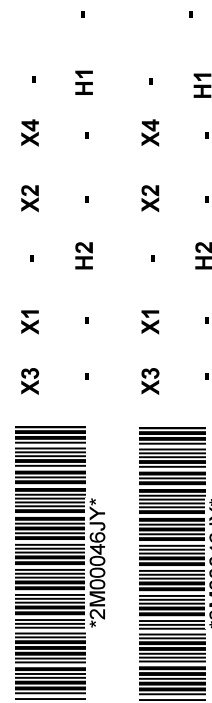

BOÎTIER TYPE 2(IP20) À L'ÉPREUVE DES ÉGOUTTEMENTS. BOÎTIER TYPE 3R (IP22). À L'ÉPREUVE DES INTEMPÉRIES LORSQUE FOURNI AVEC ÉCRAN 9T18Y1071G06

VOIR INSTRUCTION 475A667AAP001 AVANT LA MANIPULATION, L'INSTALLATION OU L'OPÉRATION

COPPER CONDUCTEUR    PRIMAIRE: 10 KV BIL    SECONDAIRE: 10 KV BIL

**LAISSER UNE ESPACE DE 6 POUCHES POUR ASSURER UNE VENTILATION ADÉQUATE. VÉRIFIER LES CONSIGNES DU CODE ÉLECTRIQUE CANADIEN OU AUTRES CODES.**

TRANSFORMATEUR À SEC NEMA CLASSE AA

Conforme au rendement DOE 2016

### ASSEMBLÉ AU MEXIQUE

X3 X1 - X2 X4 -  
- - H2 - - H1

Note:

Schéma: 303B409CAP073

Conforme au CSA C802.2-18



\*2M00046JY\*



\*3M00046JY\*