



DEH-41414 Installation Instructions

Introduction Pushbutton Padlock Device:

The optional pack contains a Pushbutton lock kit, which has to be fixed in the fascia. It denies unauthorized access to the ON/OFF Pushbuttons.



Cat No. GPBDR

Use the following procedure to install the Pushbutton Padlock Device accessory into the circuit breaker.

1. Turn the breaker off and discharge the closing springs by depressing the OFF and ON buttons in the sequence OFF-ON-OFF. Verify that the breaker OFF-ON indicator shows OFF on a green background and that the charge indicator shows DISCHARGE on a white background. If installing in a draw-out type breaker remove breaker from adaptor (cassette) before continuing.

EntelliGuard® G Circuit Breaker Accessories

Pushbutton Padlock Device



WARNING: Before installing any accessories, turn the breaker OFF, disconnect it from all voltage sources, and discharge the closing springs.



AVERTISSEMENT: Avant d'installer tout accessoire, mettre le disjoncteur en position OFF, le déconnecter de toute tension d'alimentation, et décharger les ressorts d'armement

2. Loosen the 6 screws on front cover (fascia) using a posidrive screw driver as shown in Fig 1.B Rotate the charging handle down and slide the front cover over the handle to remove the front cover as shown in Fig. 1.C.



Figure 1. (A) Front Cover (B) Screw Removal (C) Handle Rotation

3. Knock out the regions shown in Fig. 2 in fascia to locate the push button lock kit.

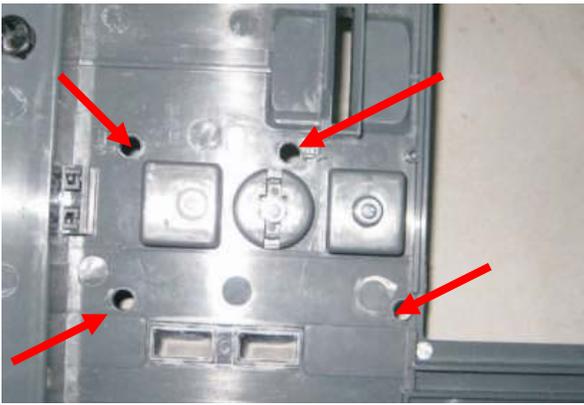


Figure 2.

4. Fix the Padlocking device kit with fascia using the screws provided refer Fig. 3

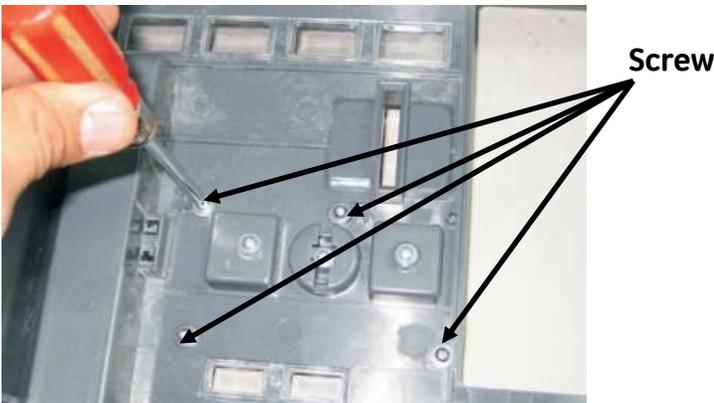


Figure 3: Assembly of Padlock Device

5. Raise the appropriate windows of ON/OFF buttons. Install padlock hasp through the locking eye (Fig. 4). Padlock hasp can be of 3 to 8mm diameter.



Figure 4: Fixing the screws

6. To Reinstall the cover, rotate the charging handle down and slide the front cover over the handle to assemble the front cover to housing as shown in Fig. 5.



Figure 5.

7. Ensure the fascia is aligned properly with the trip unit and the pad lock features of the breaker.

8. Fasten the 6 mounting screws of fascia with the housing using a pozidrive screwdriver. Apply torque of 6 Nm (4.42 ft-lbs).

Reference:

These instructions do not purport to cover all details or variations in equipment nor, to provide contingency to be met in connection with installation, operation, or maintenance. Should further information be desired, or should particular problems arise which are not covered sufficiently for the purchaser's purposes, the matter should be referred to GE.

GE
41 Woodford Ave, Plainville, CT 06062
www.geelectrical.com

© 2009 General Electric Company



DEH-41414 R1 (03/09)