


CERTIFICATE OF SEISMIC COMPLIANCE

For Types TG, TH, TC and TS Safety Switches

Qualified to IEEE-693-2005 and IBC-2012

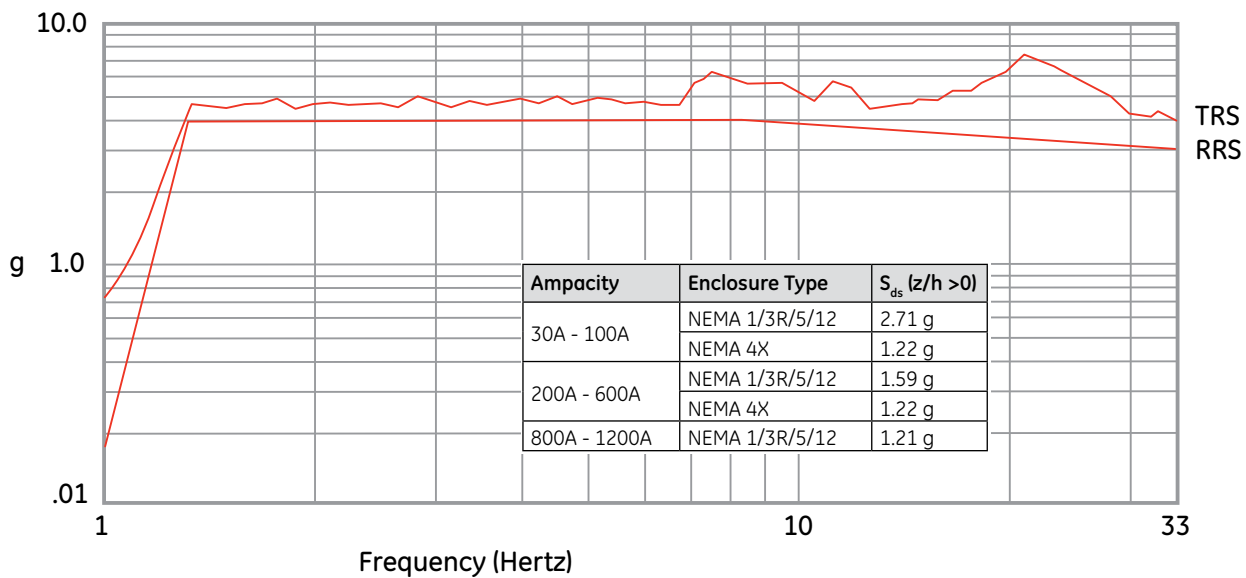

Lowest equipment natural frequency: 14 Hz Qualified by shake-table testing, Clark Testing Laboratory, August 2012

The acceleration response plot shown above represents test sample UUT-1: 100 amp, Type 3R, General Duty safety switch catalog number TGN3323R. Refer to the table for specific seismic ratings by switch ampacity and enclosure type.

THIS IS TO CERTIFY THAT THE ABOVE NAMED EQUIPMENT MEETS OR EXCEEDS ALL OF THE ABOVE REQUIREMENTS ACCORDING TO IEEE-693-2005 AND IBC-2012.

Certification Report Prepared by

Forell/Elsesser Engineers, Inc.

160 Pine Street

San Francisco, CA 94111

See GE document 10095950P2 for Certification Report, interpretation of test data and P.E. stamp.

