


CERTIFICATE OF SEISMIC COMPLIANCE

For Spectra & Jiffy Series Switchboards

Qualified to IEEE-693-2005

Qualified to IBC-2006

$S_{ds} = 1.05g$, $S_s = 158\%$, $I_p = 1.5$, for $z/h > 0$
 $S_{ds} = 1.67g$, $S_s = 250\%$, $I_p = 1.5$, for $z/h = 0$
in accordance with ICC-ES-AC156.

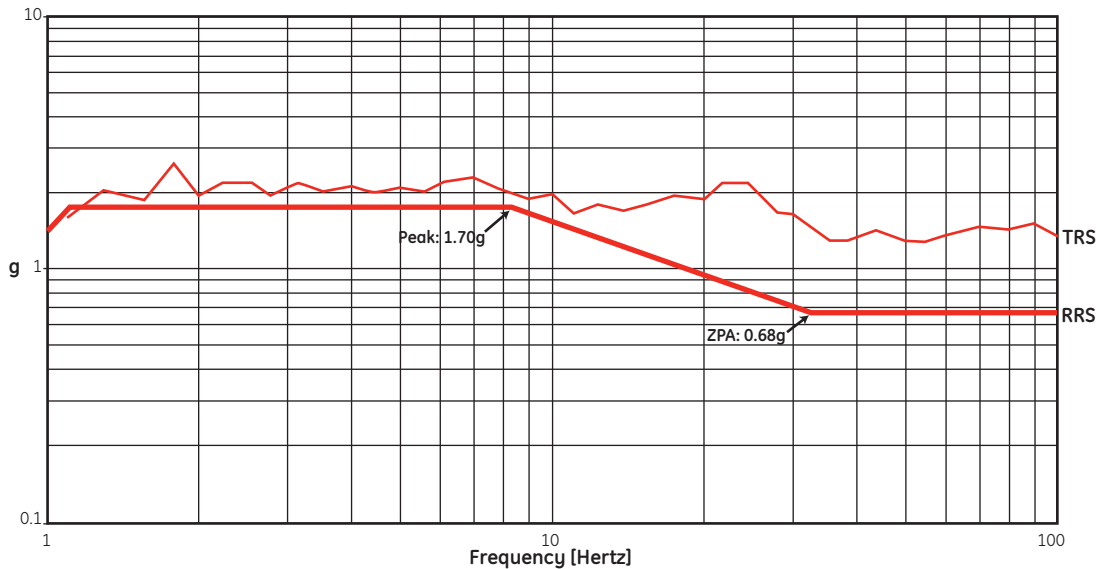

Lowest equipment natural frequency: 4.5 Hz Qualified by shake-table testing, Wyle Laboratories, May 1998,
Jul. 1998, Mar. 2001

**THIS IS TO CERTIFY THAT THE ABOVE NAMED EQUIPMENT MEETS OR EXCEEDS
ALL OF THE ABOVE REQUIREMENTS ACCORDING TO IEEE-693-2005 AND IBC-2006.**

Certification Report Prepared by

W. E. Gundy & Associates, Inc.
P.O.Box 2900, Hailey, ID, 83333

See GE document 10095999P1 for Certification Report, interpretation of test data and P.E. stamp.

