


Side View

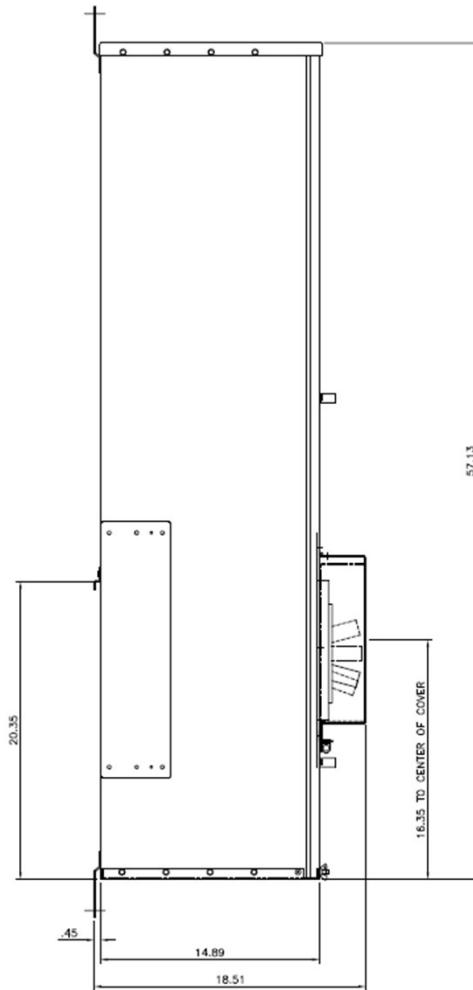

Notes:

No Knockouts in Endwalls


Fixed rating plug, not field adjustable

This unit meets NEC 2014 Section 240.87 by providing an arc flash maintenance switch factory installed

Incoming Cable Sizes:

(4) 500-1000MCM/ Phase&Neutral (AL & CU)

Front View

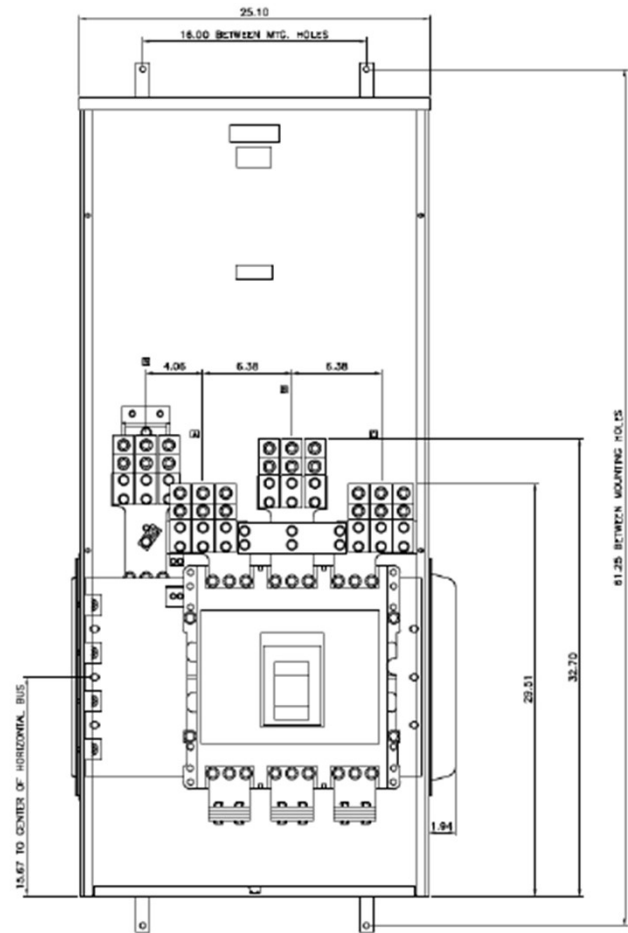

imagination at work

METER MOD III-1600A MAIN BREAKER SECT N3R ENCL
100KAIC 3PH4W 208Y/120V TOP FEED ARC REDUCTION

REF NO	CAT NO	DWG DATE	REV #
96-5557	TMP3BT16RAR	1/15/2016	01